

FIRE COMPANY CERTIFICATION:

NAME & TITLE

NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION:

NAME & TITLE

FREEZE PROTECTION

8" PVC FROM HEAD ASS'Y TO BELOW NORMAL WATER: ANNULAR SPACE FILLED WITH INSULATION FOAM. (PREMOLDED OR EXPANDING FOAM)

GUARD POSTS - SEE NOTE #1

YES ___ NO ___


YES

NO

NOTES:


1. GUARD POSTS, IF REQUIRED, SHALL BE _____

2. ANCHORS SHALL BE _____

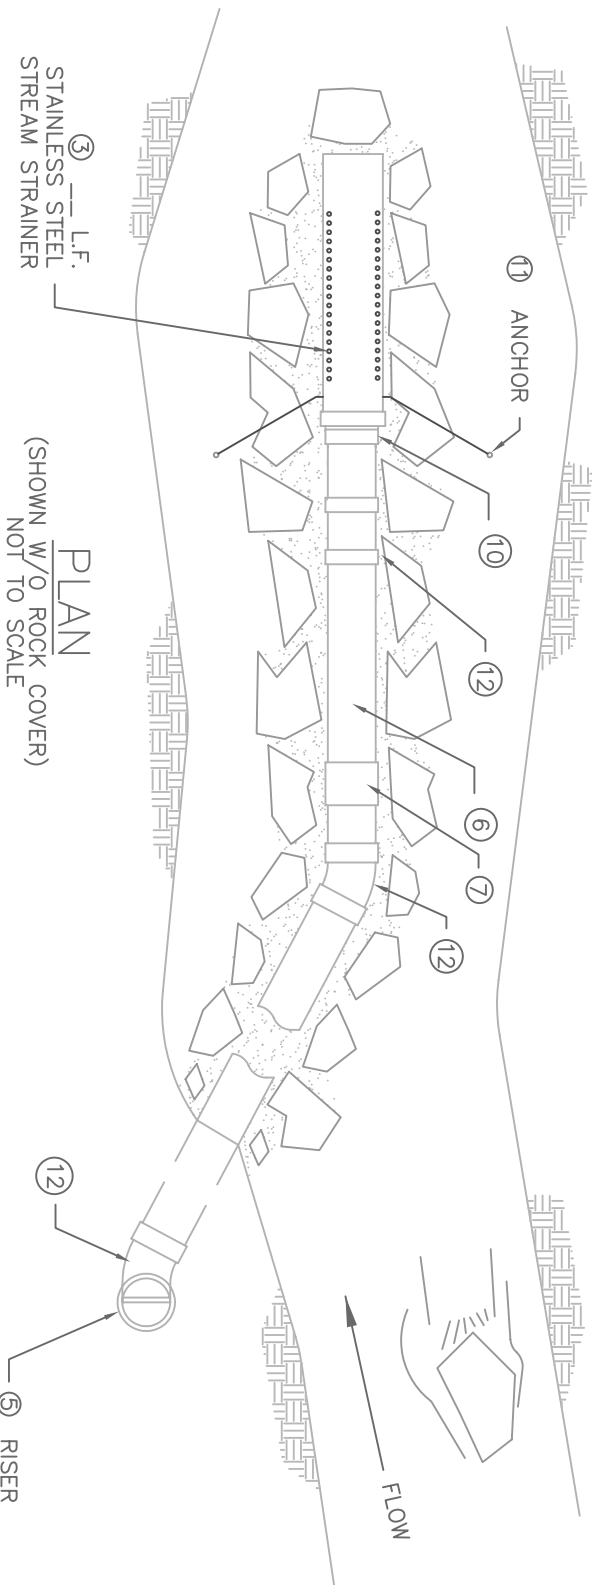

BILL OF MATERIALS			
ITEM	MARK	QUAN.	UNIT
4" HYDRANT ASSEMBLY - 90° BEND	1	1	EACH
HYDRANT CAP	2	1	EACH
4" STAINLESS STEEL STRAINER	3	1	IN. FT.
4" SCH. 40 PVC 90° ELBOW	4	1	EACH
4" SCH. 40 PVC PIPE-RISER	5	1	IN. FT.
4" SCH. 40 PVC PIPE	6	1	IN. FT.
4" SCH. 40 PVC COUPLINGS	7	1	EACH
PRIMER CLEANER	8	1	CAN
PVC GLUE	9	1	EACH
PVC - STEEL COUPLING	10	1	EACH
ANCHOR	11	2	EACH
4" SCH. 40 PVC 45° ELBOW	12	2	EACH
R-___ RIP-RAP	13	1	C.Y.

SITE DATA	
ITEM	
NORMAL STREAM DISCHARGE AVAILABLE WATER AT NORMAL LEVEL	___ G.P.M. G.P.M.

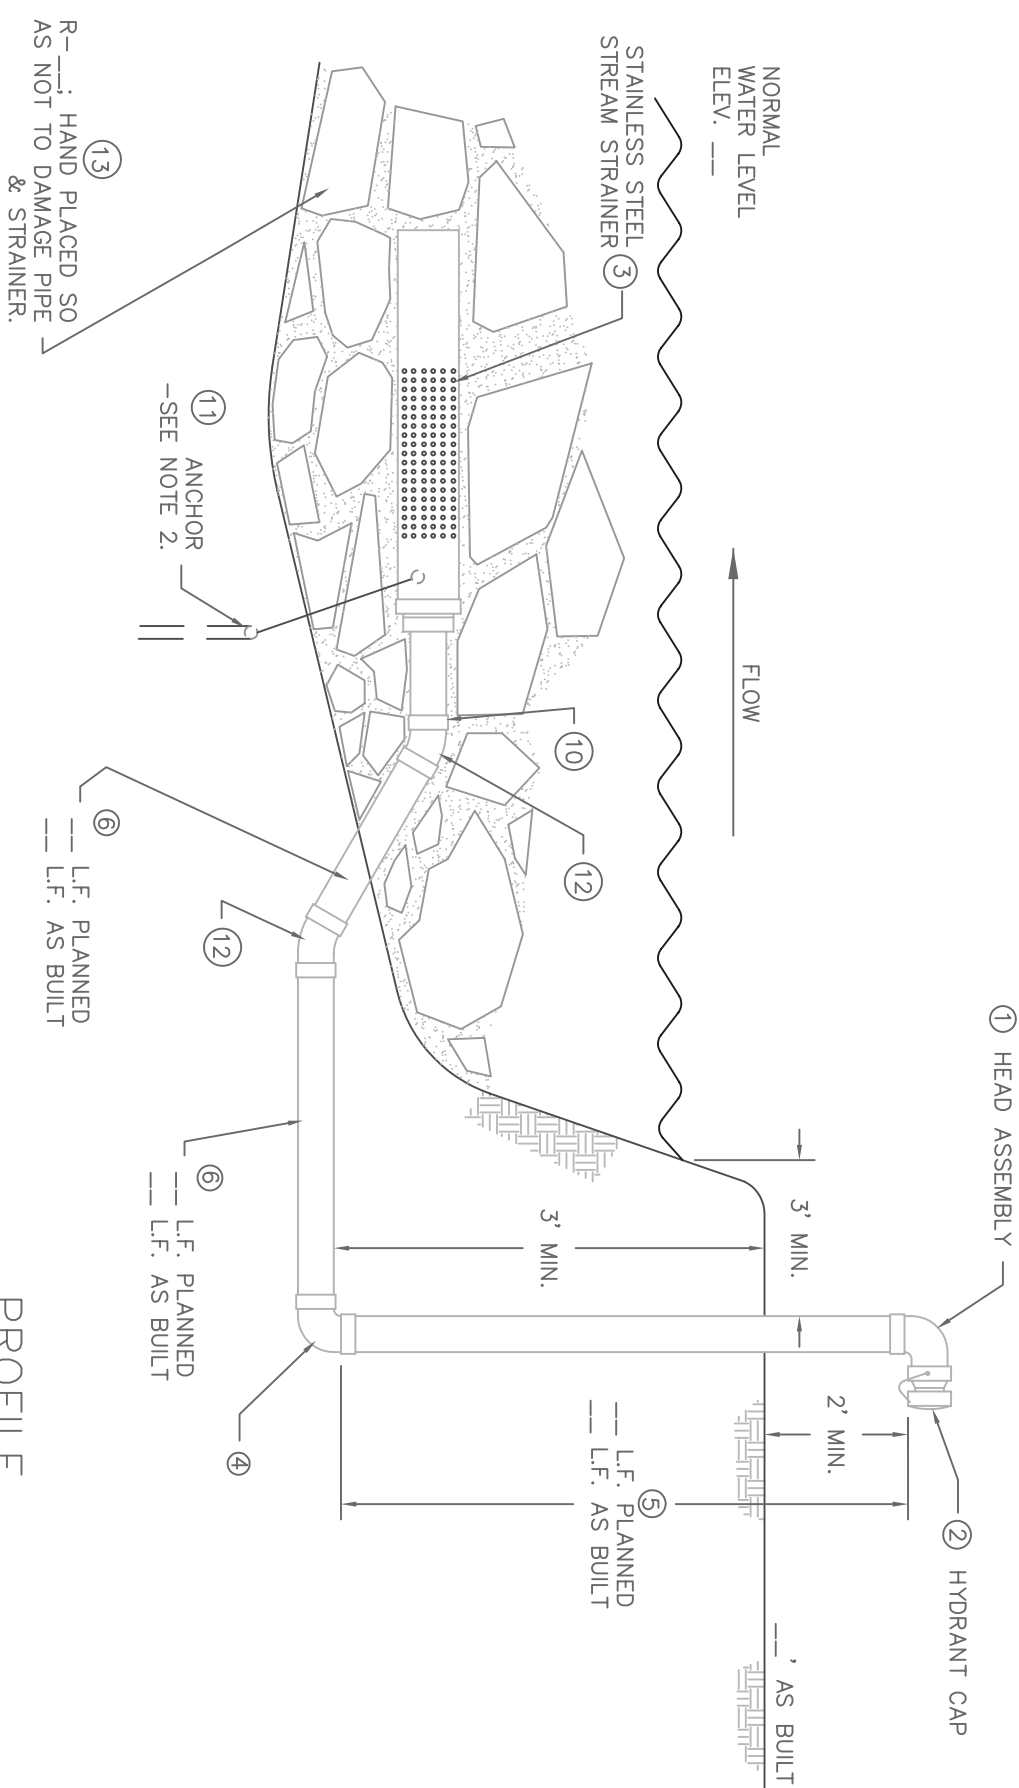

_____ COUNTY, PENNSYLVANIA

4" DRY HYDRANT - SHALLOW STREAM INSTALLATION

Date

Designed

Drawn

D. GORDON

Checked

Approved by



File No.

P4-059A.dwg

Drawing No.

P4-059A

Sheet

of
